



SCALE $\frac{1}{8}" = 1'-0"$



SCALE $\frac{1}{2}" = 1'-0"$




SCALE $\frac{1}{2}'' = 1'-0''$




SCALE 1/8" = 1'-0"

1. STRIP ALL TOP SOIL AND OTHER UNSUITABLE SOILS TO A DEPTH NECESSARY TO OBTAIN 3000 PSF SOIL BEARING CAPACITY.
2. ALL FILL WITHIN THE BUILDING LIMITS SHALL BE GRANULAR MATERIAL COMPACTED TO 95% DENSITY.
3. CONCRETE SHALL BE A MINIMUM 4" AGG MIX AND SHALL ATTAIN A COMPRESSIVE STRENGTH OF 3500 PSI @ 28 DAYS.
4. CONCRETE REINFORCING BARS SHALL BE GRADE 60.
5. BUILDING COMPONENTS SHALL BE DESIGNED FOR:
 - 20 PSF WIND LOAD
 - 30 PSF SNOW LOAD
 - 3 PSF SERVICE LOAD
 - ALL APPLICABLE DEAD LOADS
6. ALL TRAILS SHALL OBTAIN STATE & LOCAL APPROVALS FOR THEIR WORK.
7. SITE GRADES & BUILDING ELEVATION TO BE ESTABLISHED BY THE OWNER.
8. THE TOILET ROOMS & SHOWER ROOM SHALL HAVE PAINTED CONCRETE FLOORS, 6" CERAMIC BASE, AND PAINTED GIB WALLS & CEILINGS.
9. THE FACILITY IS DESIGNED TO ACCOMMODATE 60 EMPLOYEES AND LESS THAN 25 PATIENTS.

- A-1 PARTIAL SITE PLAN; SKID ELEVATIONS; GENERAL NOTES
- A-2 FLOOR PLAN; REFLECTED CEILING PLAN; SCHEDULES
- A-3 FOUNDATION PLAN; FOOTING & A.B. DETAILS; ROOF FRAMING PLAN
- A-4 BUILDING SECTIONS; STORAGE BINS PLAN & SECTION

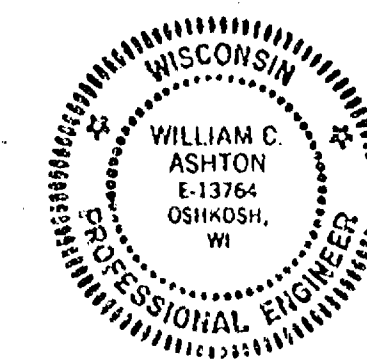

William C. Astle.



SCALE 1" = 30'



NORTH


018-0458-07

Strategic Systems
Engineering & Analysis & Construction & Maintenance
305 Washington Ave., Suite 400
Chattanooga, Tennessee 37402

PROPOSED RETAIL FACILITY
FOR
ZILLEGES MATERIALS INC.
DANKEN
WILSON


20 July '84

A-1

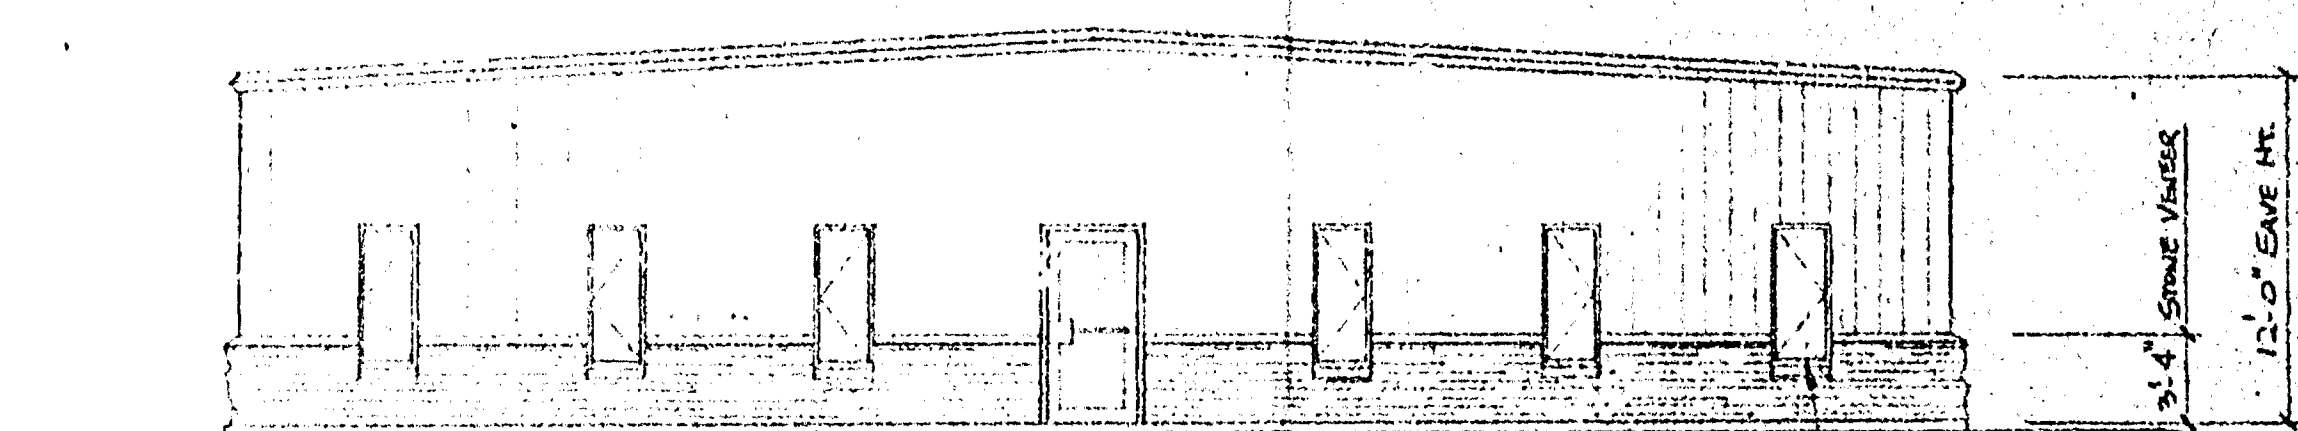


SOUTH ELEVATION
SCALE 1/8" = 1'-0"


ANDERSEN PERMA-SHIELD
CIS CASHEMENT WINDOWS
IN TERTIARY FINISH AND
BRONZE-TINTED GLASS.

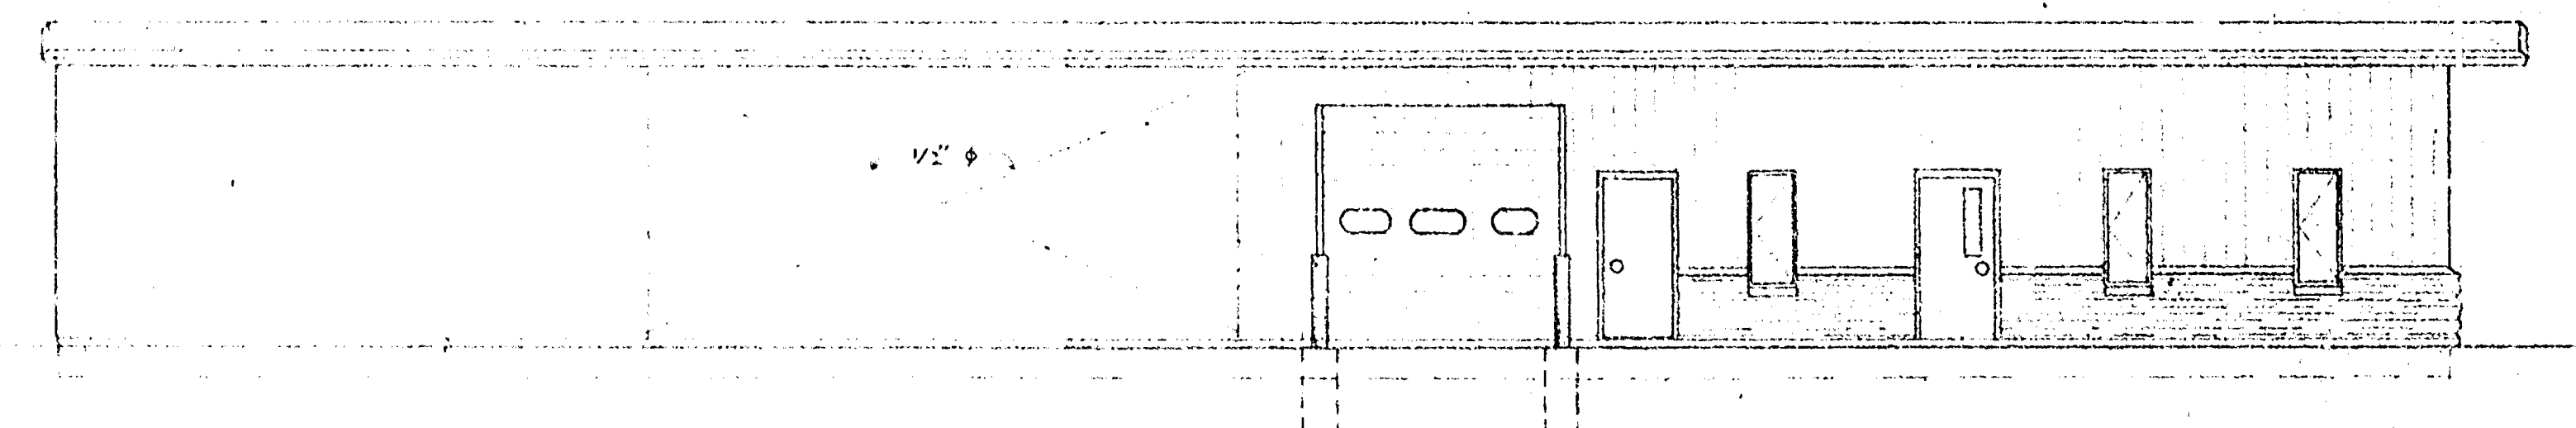

WEST ELEVATION
SCALE 1/8" = 1'-0"

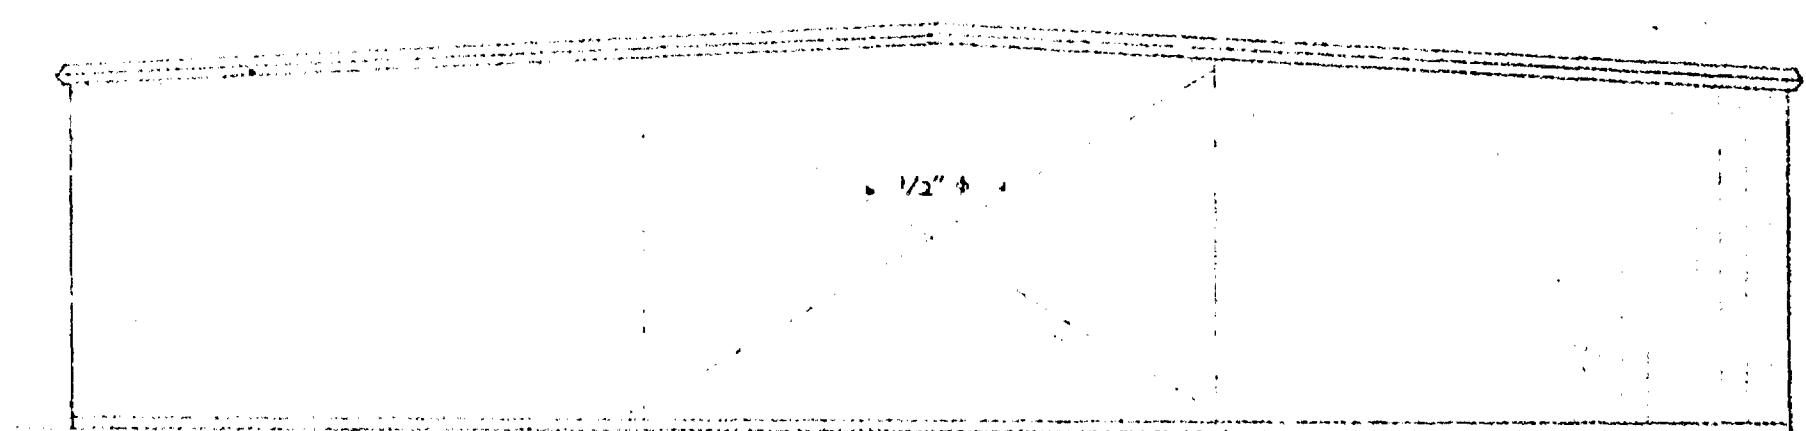

NORTH ELEVATION
SCALE 1/8" = 1'-0"

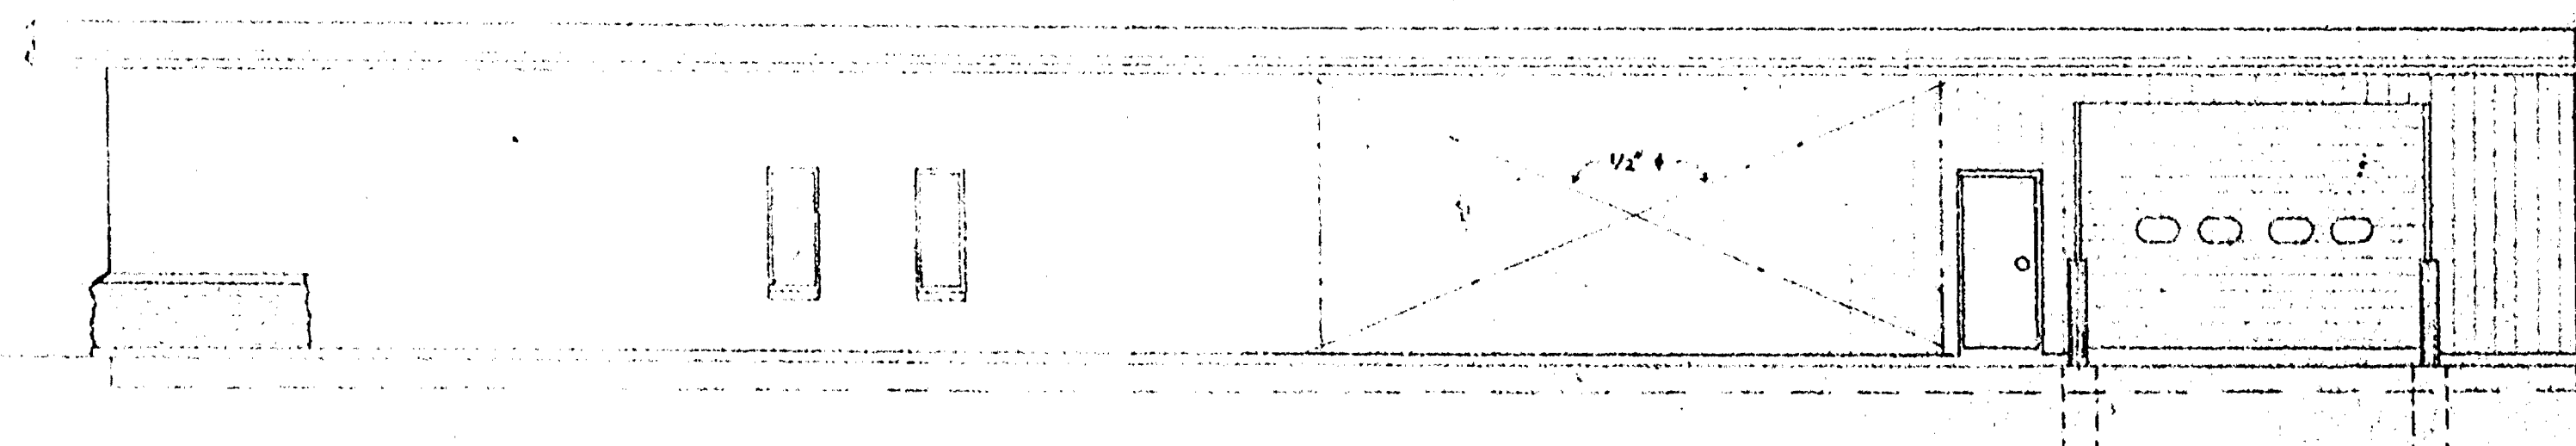


EAST ELEVATION
SCALE 1/8" = 1'-0"

GENERAL NOTES


1. STRIP ALL TOP SOIL AND OTHER UNSUITABLE SOILS TO A DEPTH NECESSARY TO OBTAIN 3000 PSF SOIL BEARING CAPACITY.
2. ALL FILL WITHIN THE BUILDING LIMITS SHALL BE GRANULAR MATERIAL COMPACTED TO 95% DENSITY.
3. CONCRETE SHALL BE A MINIMUM 5 BAG MIX AND SHALL ATTAIN A COMPRESSIVE STRENGTH OF 3500 PSI @ 28 DAYS.
4. CONCRETE REINFORCING BARS SHALL BE GRADE 60.
5. BUILDING COMPONENTS SHALL BE DESIGNED FOR:
20 PSF WIND LOAD
30 PSF SNOW LOAD
3 PSF SERVICE LOAD
ALL APPLICABLE DEAD LOADS
6. ALL TRADES SHALL OBTAIN STATE & LOCAL APPROVALS FOR THEIR WORK.
7. SITE GRADES & BUILDING ELEVATION TO BE ESTABLISHED BY THE OWNER.
8. THE TOILET ROOMS & SHOWER ROOM SHALL HAVE PAINTED CONCRETE FLOORS, 2" CERAMIC BASE, AND PAINTED GNB WALLS & CEILINGS.
9. THE FACILITY IS DESIGNED TO ACCOMMODATE 60 EMPLOYEES AND LESS THAN 25 PATRONS.

DRAWING INDEX

- A-1 PARTIAL SITE PLAN, BROW ELEVATIONS, GENERAL NOTES
- A-2 FLOOR PLAN, REFLECTED CEILING PLAN, SCHEDULES
- A-3 FOUNDATION PLAN, FOOTING & A.B. DETAILS, ROOF FRAMING PLAN
- A-4 BUILDING SECTIONS, STORAGE ZONE PLAN & SECTION

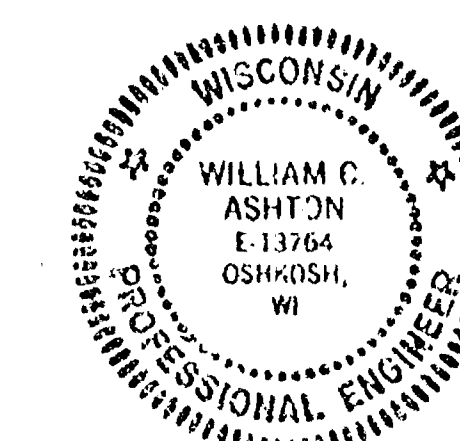

William C. Ashton

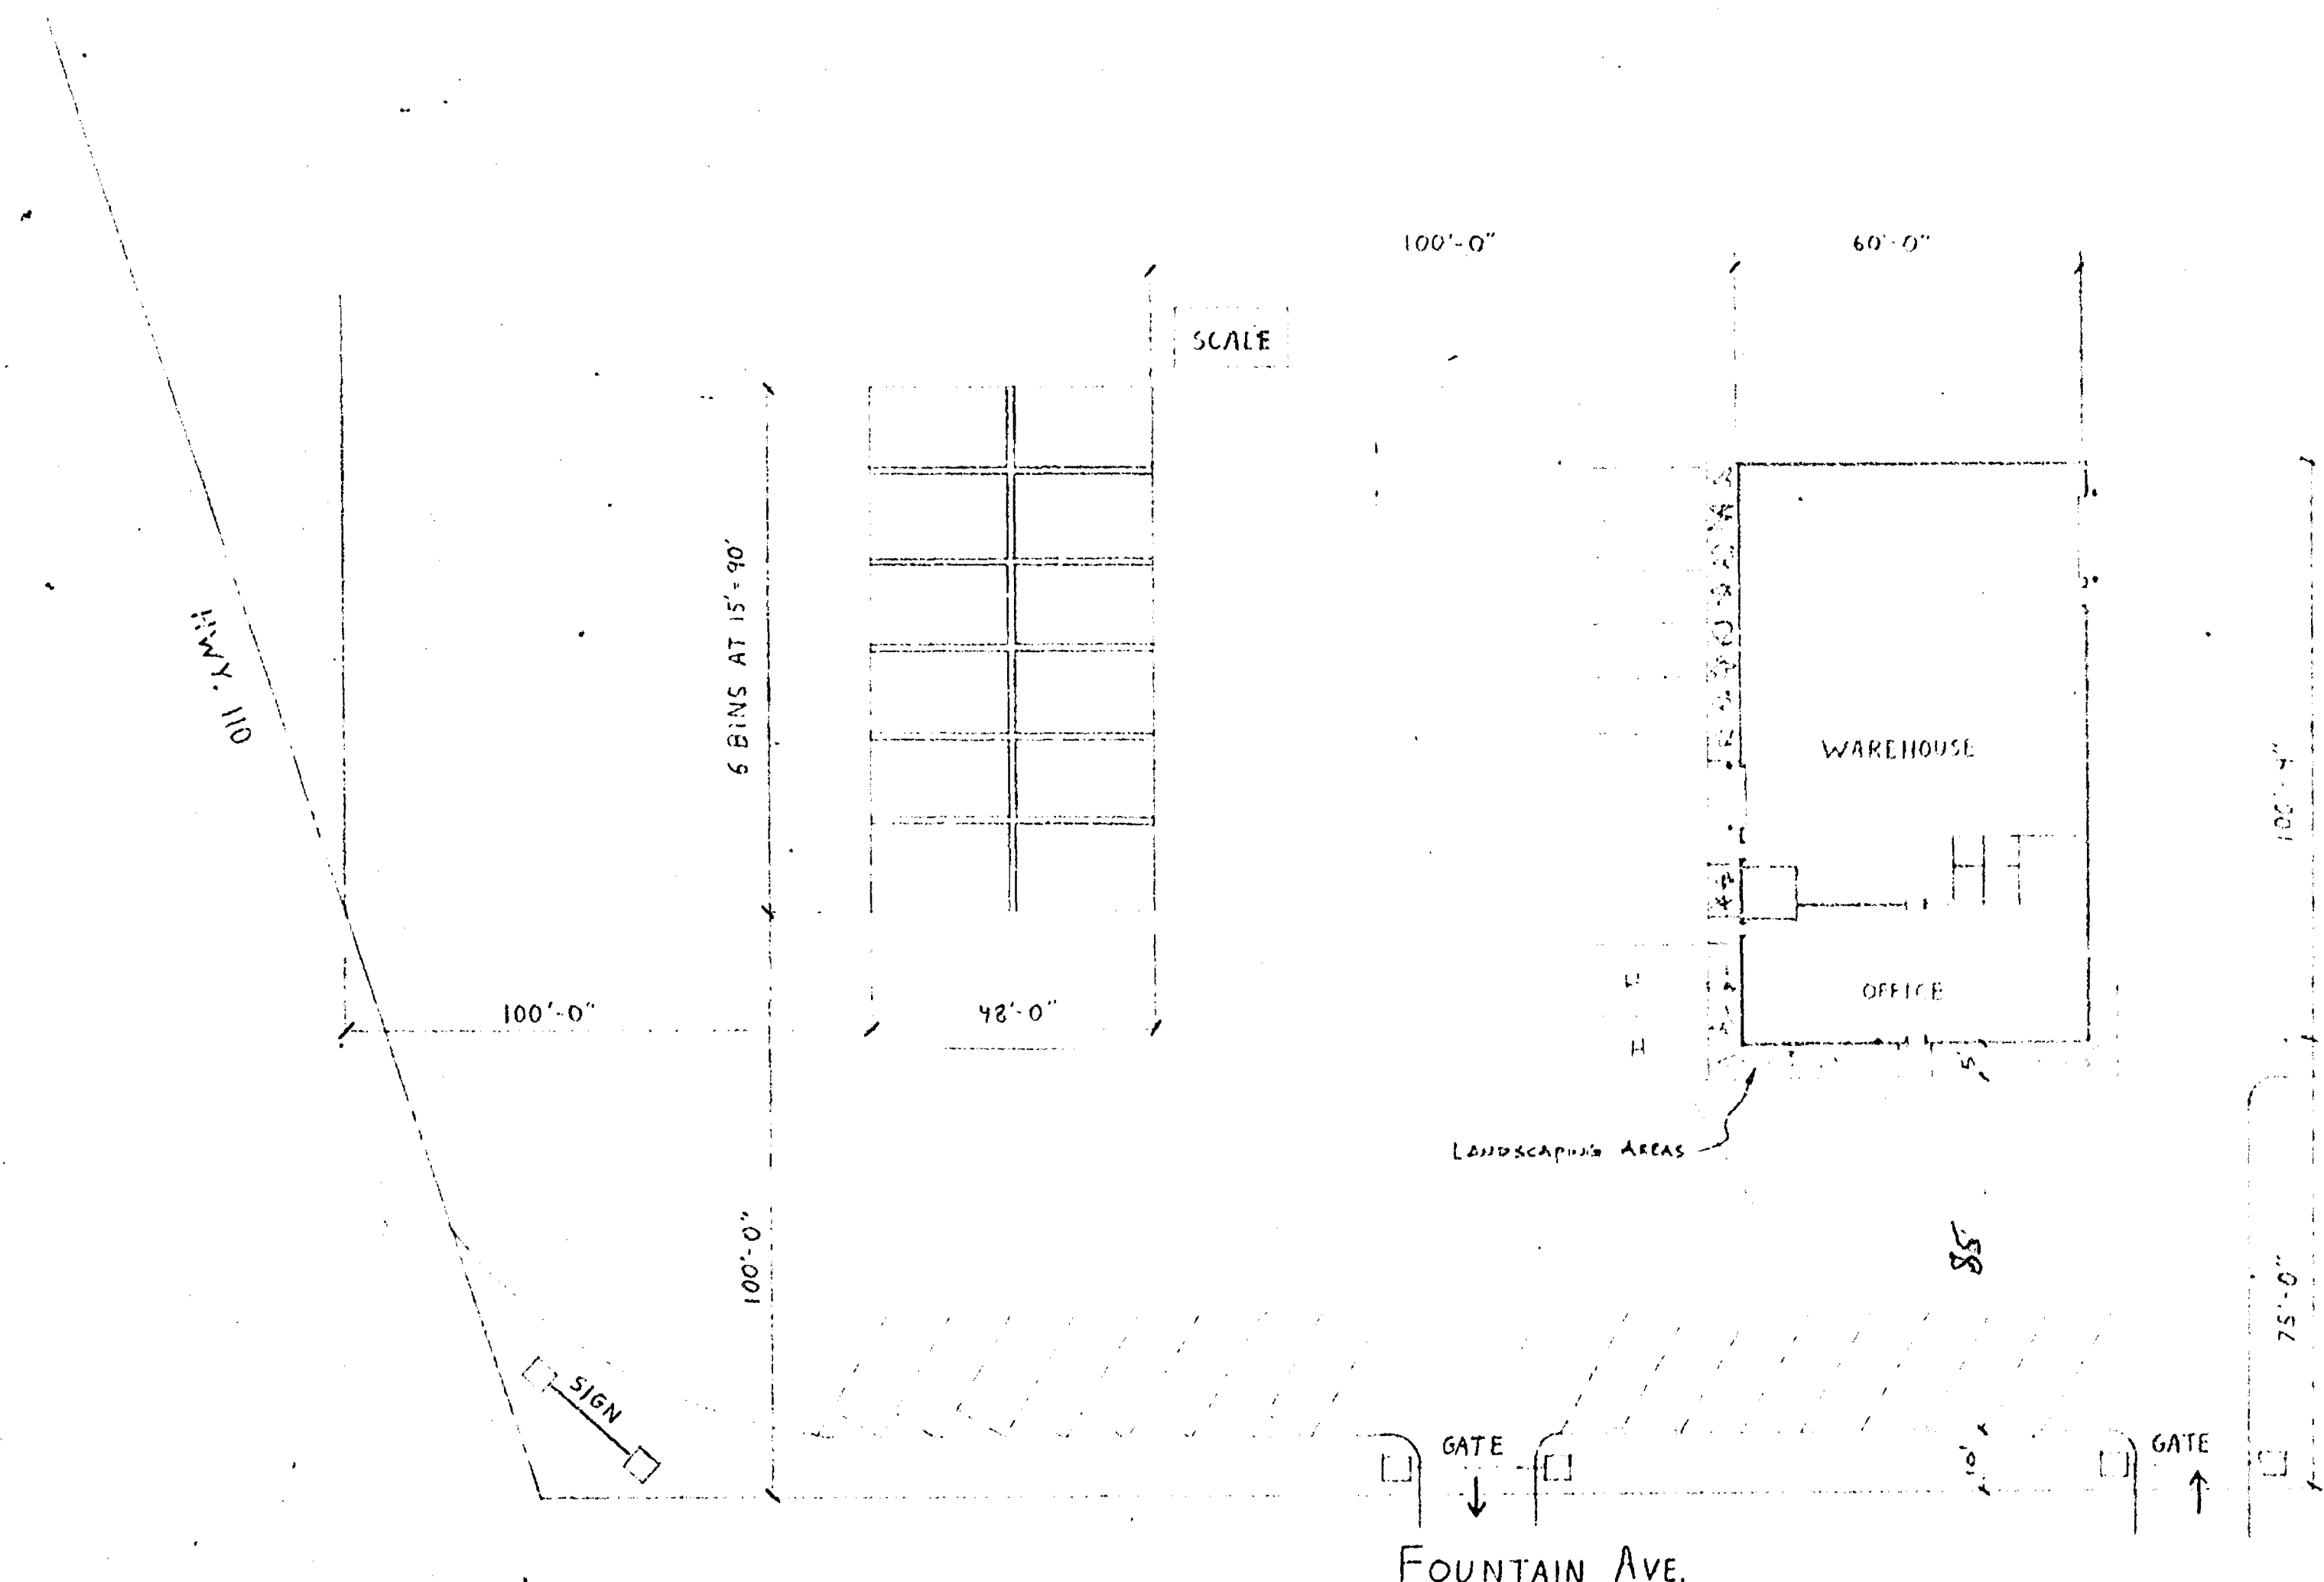

PARTIAL SITE PLAN
SCALE 1" = 30'



018-0458-07

Structural Systems
For
ZILLGES MATERIALS INC.
Oshkosh, Wisconsin
7/17/84

PROPOSED RETAIL FACILITY
FOR
ZILLGES MATERIALS INC.
Oshkosh, Wisconsin

20 July '84

A-1